



REPORT

2022 Annual Inspection Report
for CCR Surface Impoundment

Gulf Clean Energy Center Gypsum Storage Area
Pensacola, Florida

Submitted to:

Florida Power & Light Company

Submitted by:

WSP Inc.


(FKA Golder Associates USA Inc.)

5170 Peachtree Road

Bldg 100 Suite 300

Atlanta, GA 30338

January 2023

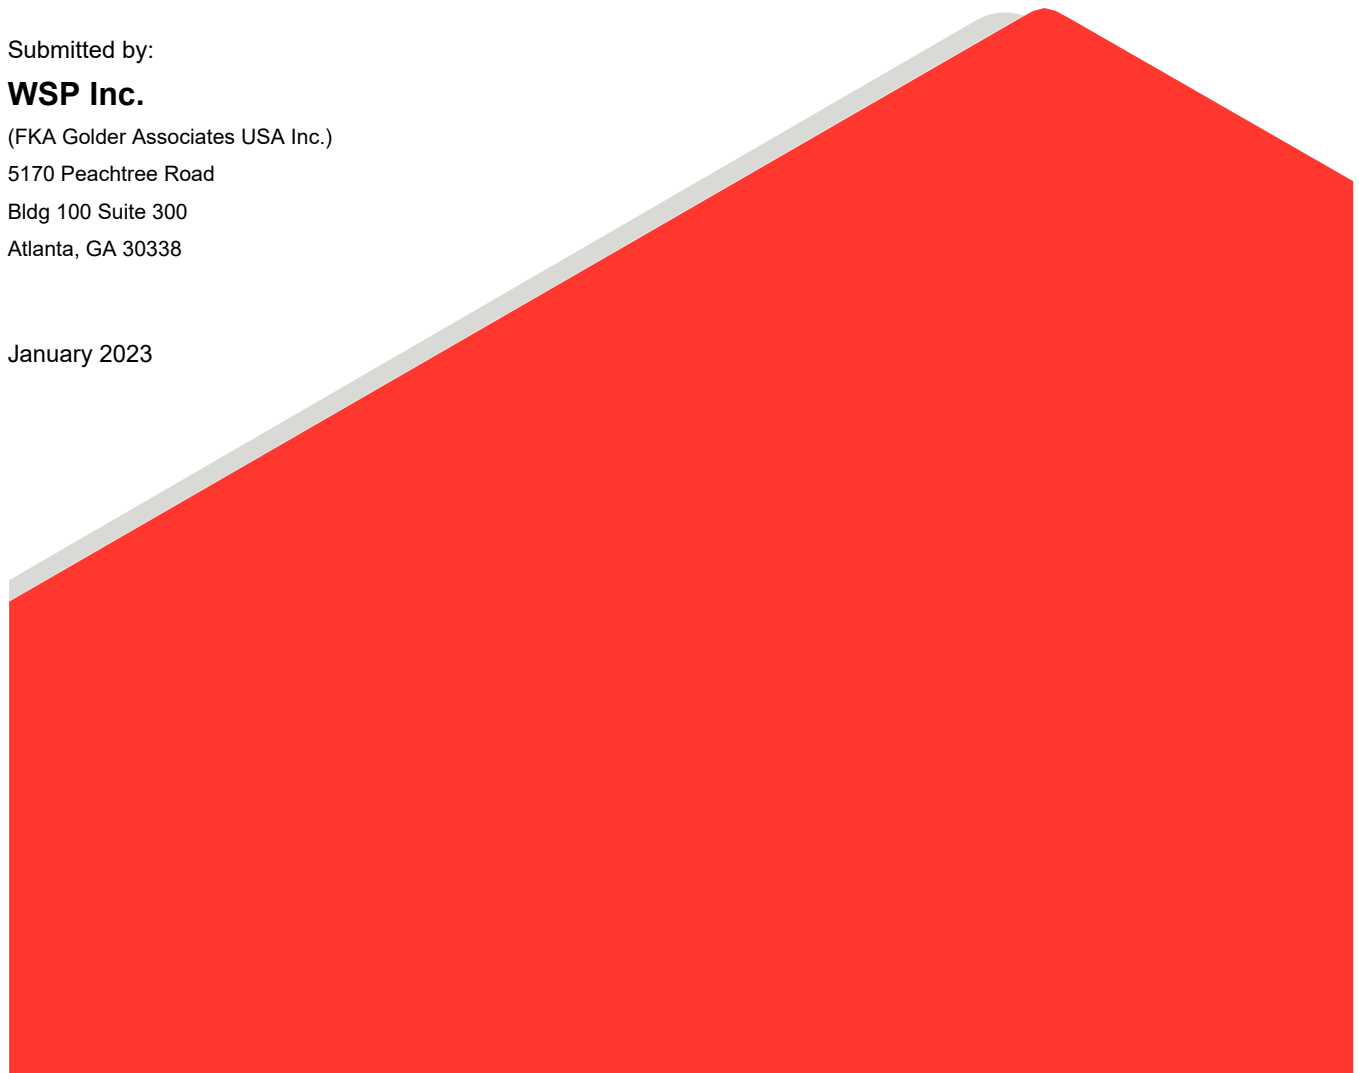

Distribution List

Florida Power & Light Company

WSP USA Inc.

INTRODUCTION

WSP USA Inc. (WSP; formerly known as Golder Associates USA Inc. – Member of WSP) performed the annual inspection for a coal combustion residuals (CCR) surface impoundment at the Gulf Clean Energy Center (GCEC) Gypsum Storage Area, located in Pensacola, Florida. This facility is owned and operated by Florida Power & Light Company (FPL). The inspection, conducted on November 16, 2022, and this report are intended to meet the requirements of 40 CFR §257.83(b). WSP's inspection was performed by Kevin S. Brown, PE.

The Gulf Clean Energy Center Gypsum Storage Area is currently inactive following the facility ceasing coal fired operations in October 2020 and is undergoing engineering design evaluation for closure by removal in accordance with 40 C.F.R. §257.102(c).

REVIEW OF AVAILABLE INFORMATION – §257.83(b)1(i)

In accordance with §257.83(b)1(i), WSP reviewed available information regarding the status and conditions of the GCEC Gypsum Storage Area. The documents reviewed included:

- Closure Plan (Rev. 01) – Gulf Clean Energy Center Gypsum Storage Area
- Structural Stability Assessment (Rev. 01) – Gulf Clean Energy Center Gypsum Storage Area
- Safety Factor Assessment (Rev. 01) – Gulf Clean Energy Center Gypsum Storage Area
- Hazard Potential Classification (Rev. 01) – Gulf Clean Energy Center Gypsum Storage Area
- Inflow Design Flood Control System Plan (2021) – Gulf Clean Energy Center Gypsum Storage Area
- History of Construction (2021) – Gulf Clean Energy Center Gypsum Storage Area
- Emergency Action Plan (2022) – Gulf Clean Energy Center Gypsum Storage Area
- Report of Annual Inspection 2021 – Gulf Clean Energy Center Gypsum Storage Area

INSPECTION SUMMARY – §257.83(b)1(ii) AND §257.83(b)1(iii)

WSP conducted a visual inspection of the GCEC Gypsum Storage Area on November 16, 2022. The inspection evaluated the geometry and conditions of the impoundment, exterior slopes, erosion and vegetative conditions, stormwater management controls, placement of coal combustion residuals (CCR), slope stability, and any other signs of distress or malfunction.

CHANGES IN GEOMETRY – §257.83(b)2(i)

Since the past annual inspection, there were no observed changes in the geometry of the impounding structure.



Figure 1: Panorama Photograph at Time of Inspection – GCEC Gypsum Storage Area

INSTRUMENTATION – §257.83(b)2(ii)

There is currently no instrumentation equipment installed at GCEC Gypsum Storage Area. As such, there are no recorded readings of instruments since the previous annual inspection.

APPROXIMATE WATER AND CCR VOLUME– §257.83(b)2(iii)

The approximate minimum and maximum depths of impounded water as of the previous annual inspection, as well as the present depth of impounded water as of November 16, 2022, are presented in Table 1 below. Note that the current area of impounded water (at the time of inspection) is localized within the center of the impoundment and the elevation is estimated based on visual observation. Similarly, the minimum depth of impounded water is assumed to be less than 3 feet as represented by current conditions while the maximum depth is estimated from discoloration of the liner on the side slope at the time of the latest inspection.

Table 1: Impounded Water at GCEC Gypsum Storage Area – 2022

Minimum Depth:	< 3 ft
Minimum Elevation:	~ 3 ft
Maximum Depth:	~ 12 ft
Maximum Elevation:	~ 41 ft-MSL
Present Depth:	< 3 ft
Present Elevation:	~32 ft-MSL

The approximate minimum and maximum depths of CCR as of the previous annual inspection, as well as the present depth of impounded CCR as of November 16, 2022, are presented in Table 2 below. Note that gypsum is actively being excavated for beneficial reuse; thus, the surface of the gypsum within the impoundment varies. The values provided below are estimated from comparing visual observations of gypsum grades to the design plan and the elevations have been corrected to mean sea level. Note that the maximum depth and elevation are based on localized stockpiles at the time of inspection, while the minimum depth and elevation are based on visual observation of areas with minimum amounts of gypsum.

Table 2: Impounded CCR at GCEC Gypsum Storage Area – 2022

Minimum Depth:	2 ft
Minimum Elevation:	30 ft-MSL
Maximum Depth:	19 ft
Maximum Elevation:	52 ft-MSL
Present Depth:	10 ft (average)
Present Elevation:	38 ft-MSL

STORAGE CAPACITY– §257.83(b)2(iv)

The impoundment capacity of the GCEC Gypsum Storage Area at the time of the inspection is estimated to be approximately 251,680 cubic yards based on the current geometry of the impoundment.

APPROXIMATE CCR AND WATER VOLUME – §257.83(b)2(v)

The volume of materials in the GCEC Gypsum Storage Area at the time of the inspection is estimated to be approximately 5,700 cubic yards of impounded water and 136,000 cubic yards of impounded CCR. The volume of impounded water is estimated from visual inspection and estimate of the area of impounded water times the estimated depth of water. The volume of impounded water is not based on survey information.

STRUCTURAL WEAKNESS AND DISRUPTING CONDITIONS – §257.83(b)2(vi)


No indications of actual or potential structural weakness were noted during the November 16, 2022 inspection or during the review of available information.

CHANGES AFFECTING STABILITY OR OPERATIONS – §257.83(b)2(vii)

Based on the November 16, 2022 inspection and review of available information, no changes from the previous inspection that may affect the operations or stability of the GCEC Gypsum Storage Area were observed.

CERTIFICATION

Based on the review of the available information noted above and of the observations and results of the annual inspection, it is my professional opinion that this report has been completed in accordance with 40 CFR 257.83(b).

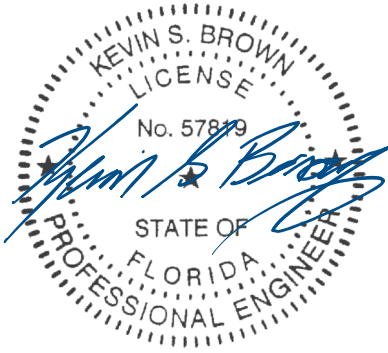

1/19/2023

Kevin S. Brown, PE
Director, Civil Engineer
Florida Professional Engineer No. 57819

Date

KSB/LS/lts

wsp **GOLDER**

golder.com